


A

Norm. Fluoro.

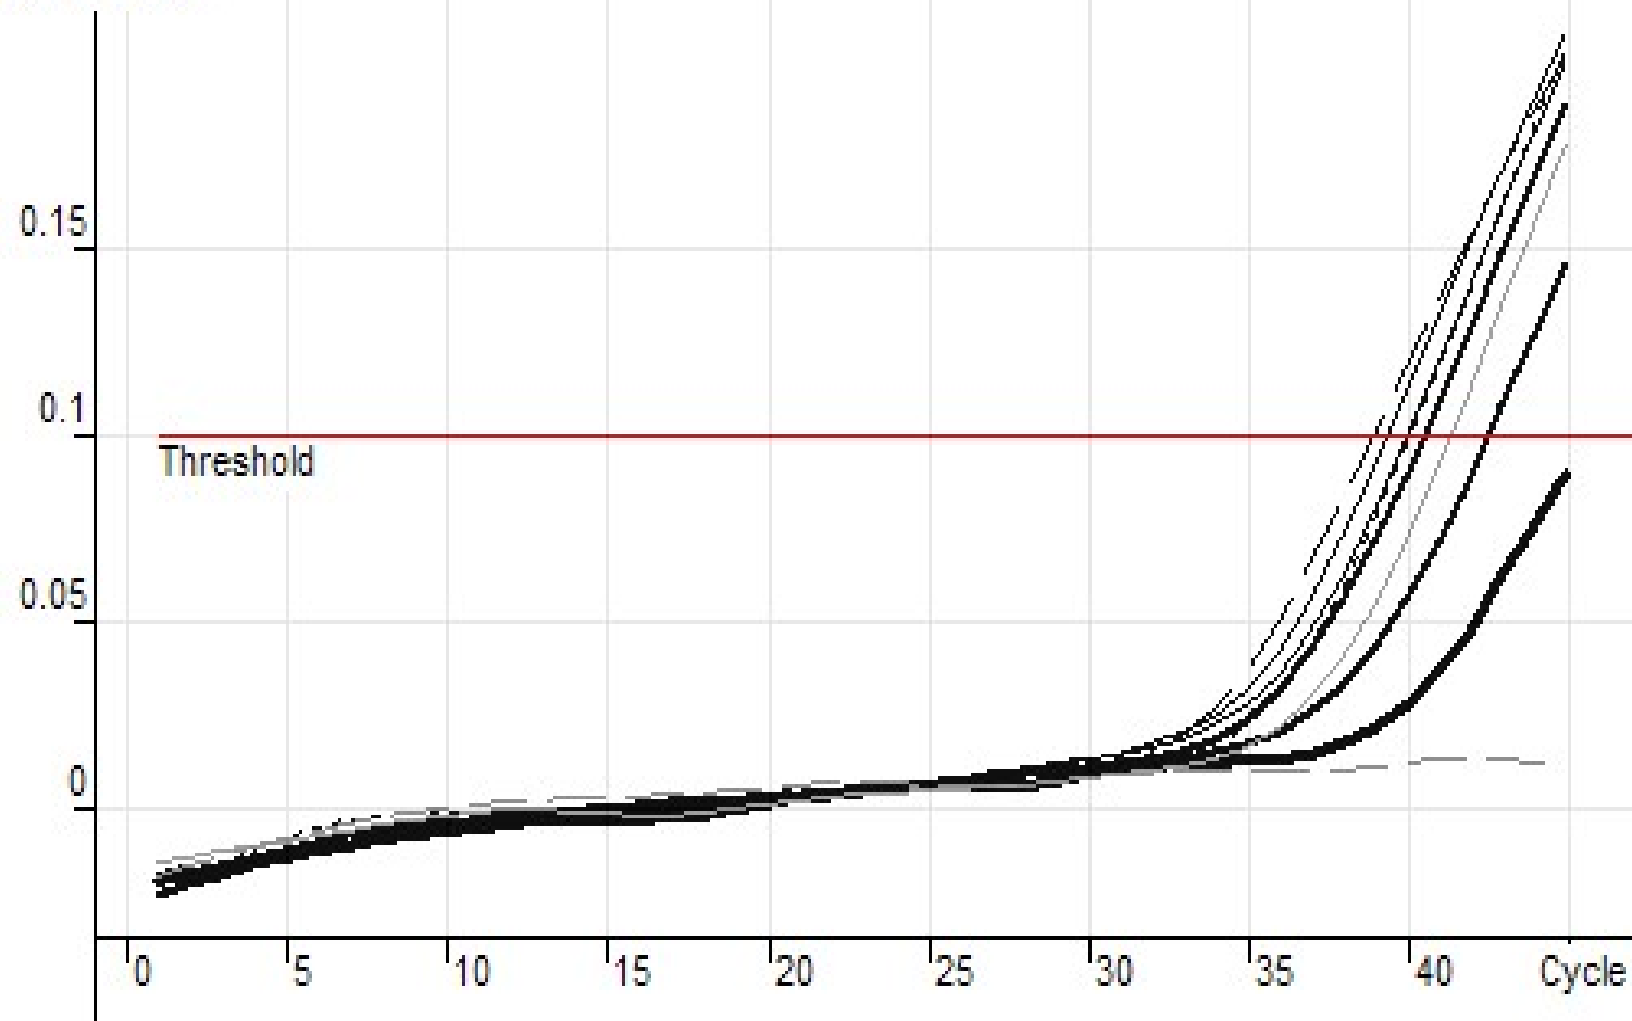

B

	Color	Sample	Ct	Calc Conc (copies/ul)	T/T
1	Dashed	Rat 1 Group 1	39.02	2 per 1 μ g of DNA	552 copies
2	Solid	Rat 2 Group 1	39.45	2 per 1 μ g of DNA	208 copies
3	Dotted	Rat 4 Group 1	40.18	1 per 1 μ g of DNA	810 copies
4	Hairline	Rat 1 Group 2	40.07	1 per 1 μ g of DNA	196 copies
5	Thin	Rat 2 Group 2	42.61	0	0
6	Thin	Rat 4 Group 2	40.59	1 per 1 μ g of DNA	96 copies
7	Thick	Rat 5 Group 2		0	0
8	Solid	Rat 4 Group 3	41.42	0	0
9	Dashed	Neg. Control		0	0